

Replacement Parts

The PRF filter comes with a 200 mesh stainless steel filter installed.

RBY-200-SS-MX	200 mesh stainless steel filter element
---------------	---

Operation Range

Flow	0.2 to 5.0 gpm (0,8 to 18,9 l/m)
Inlet Pressure	20 to 150 psi (1,8 to 10,3 bar)
Outlet Pressure	Regulated at 30 psi (2,1 bar)
Water Temperature	33°F (0,5°C) to 110°F (43°C)
Ambient Temperature	33°F (0,5°C) to 125°F (52°C)
Valve Voltage	24 VAC 50/60 Hz (cycles/sec)

Related Products

XFD-XX-XX-XXX	XF Series Dripline Available in 0.6 or 0.9 GPH at 12", 18", or 24" spacing.
---------------	--

Rain Bird Corporation
970 West Sierra Madre Avenue, Azusa, CA 91702, U.S.A.
Phone: (626) 812-3400 Fax: (626) 812-3411

Rain Bird Corporation
6991 East Southpoint Road, Tucson, AZ, 85706, U.S.A.
Phone: (520) 741-6100 Fax: (520) 741-6522

Rain Bird International, Inc.
P.O. Box 37, Glendora, CA, 91740-0037, U.S.A.
Phone: (626) 963-9311 Fax: (626) 852-7343


www.rainbird.com

The Intelligent Use of Water™ -- Visit www.rainbird.com to learn about our efforts

® Registered trademark of Rain Bird Corporation
© 2008 Rain Bird Corporation 7/08

RAIN BIRD®

1" Low-Flow Control Zone Kit with 3/4" Pressure Regulating Filter

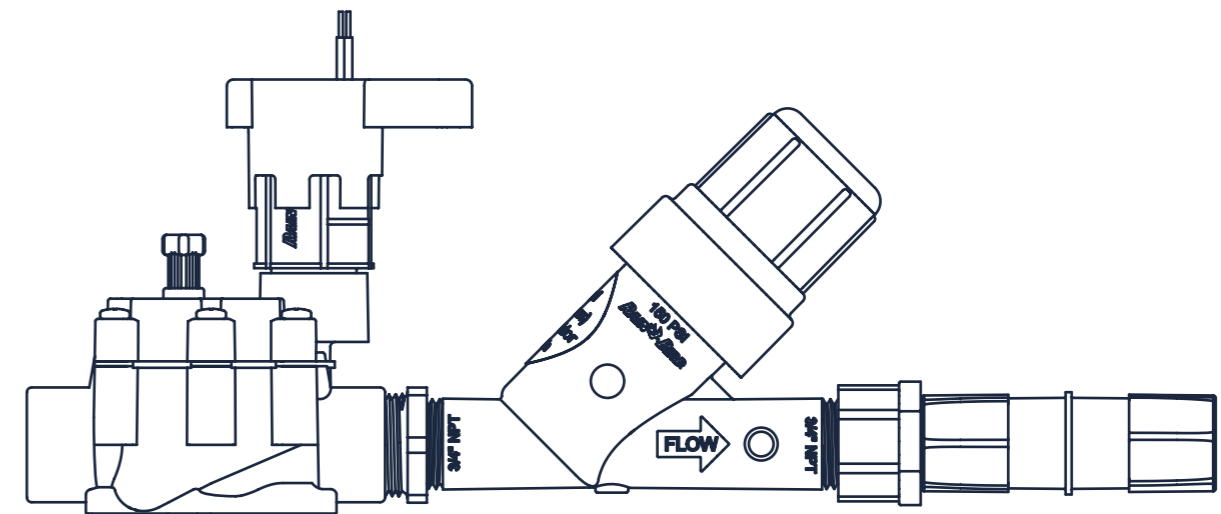


Model:
XCZ-LF-100

Installation and Operation

 **Xerigation®**


P/N 177630
26JN17

Assembly

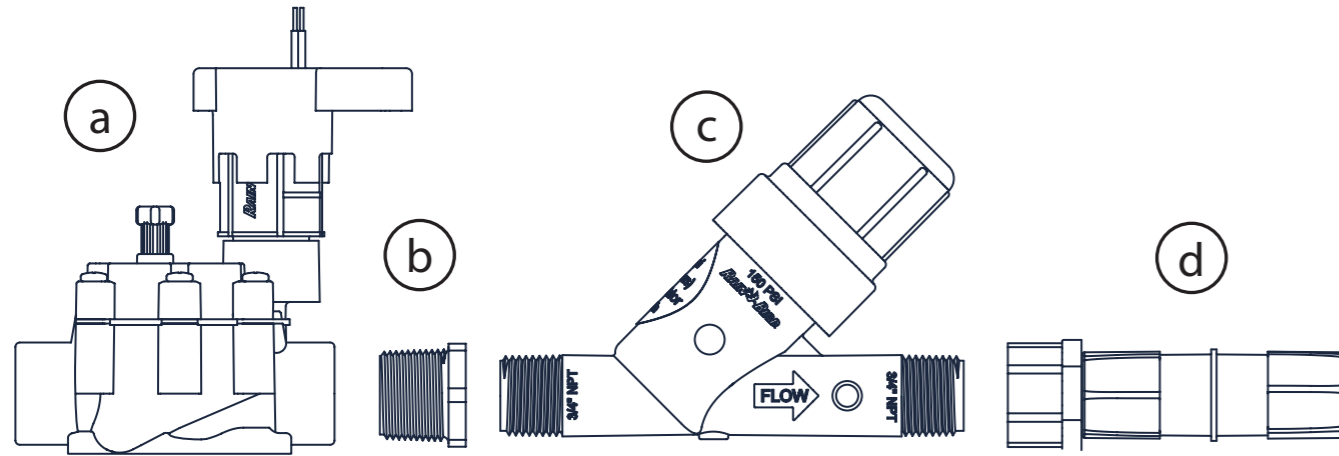


1. Apply Teflon™ tape (1 ½ to 2 turns) to all male pipe threads.
Do not use pipe thread or pipe dope compound.
2. Hand tighten components in the above configuration, no more than 2 turns past finger tight. Make sure the flow arrow on the filter is in the correct orientation.
 - a. Low flow valve - 1" female NPT to 1" female NPT
 - b. Reducer bushing - 1" male NPT to ¾" female NPT
 - c. Pressure-regulating filter (PRF) - ¾" male NPT x ¾" male NPT
 - d. Multi-diameter fitting (MDF) - ¾" female NPT to poly tubing

Installation

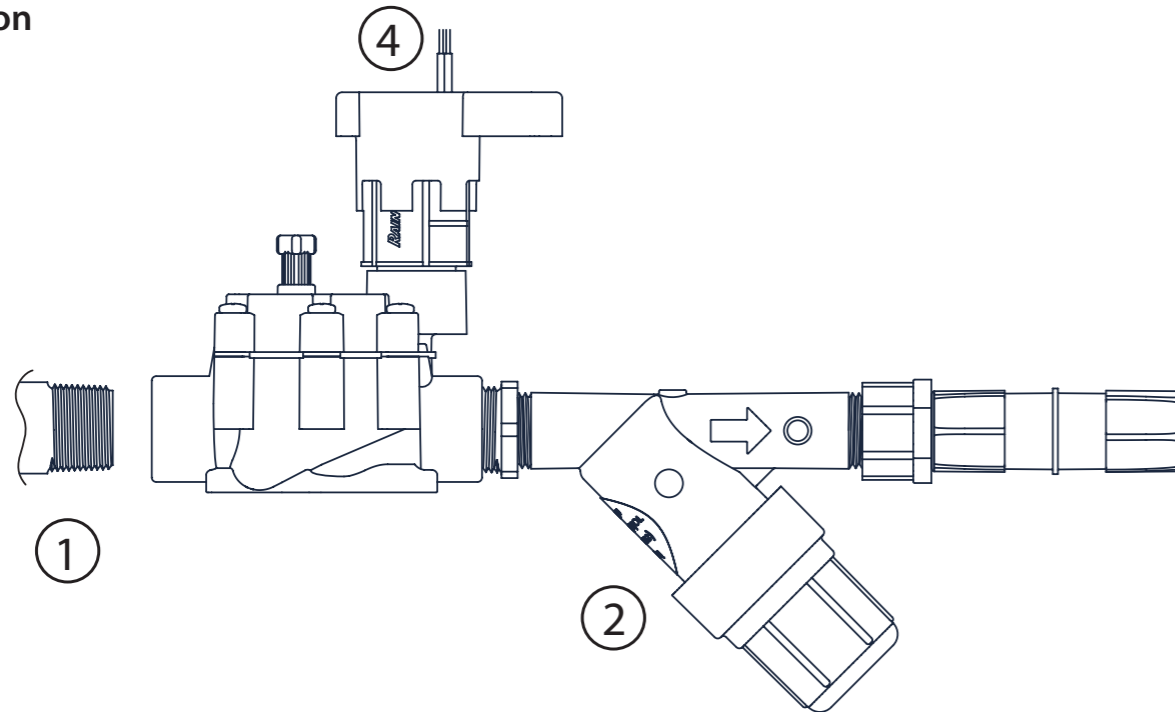

1. Install the Low Flow Valve on the water supply line.
2. Orient the Pressure-regulating filter down to prevent debris entering the line when the filter is removed for cleaning.
3. Do not install tubing or other downstream elements yet.
4. Connect one solenoid wire to the controller common and the other wire to the controller power. Use only water-tight connectors, such as Rain Bird ST-03.

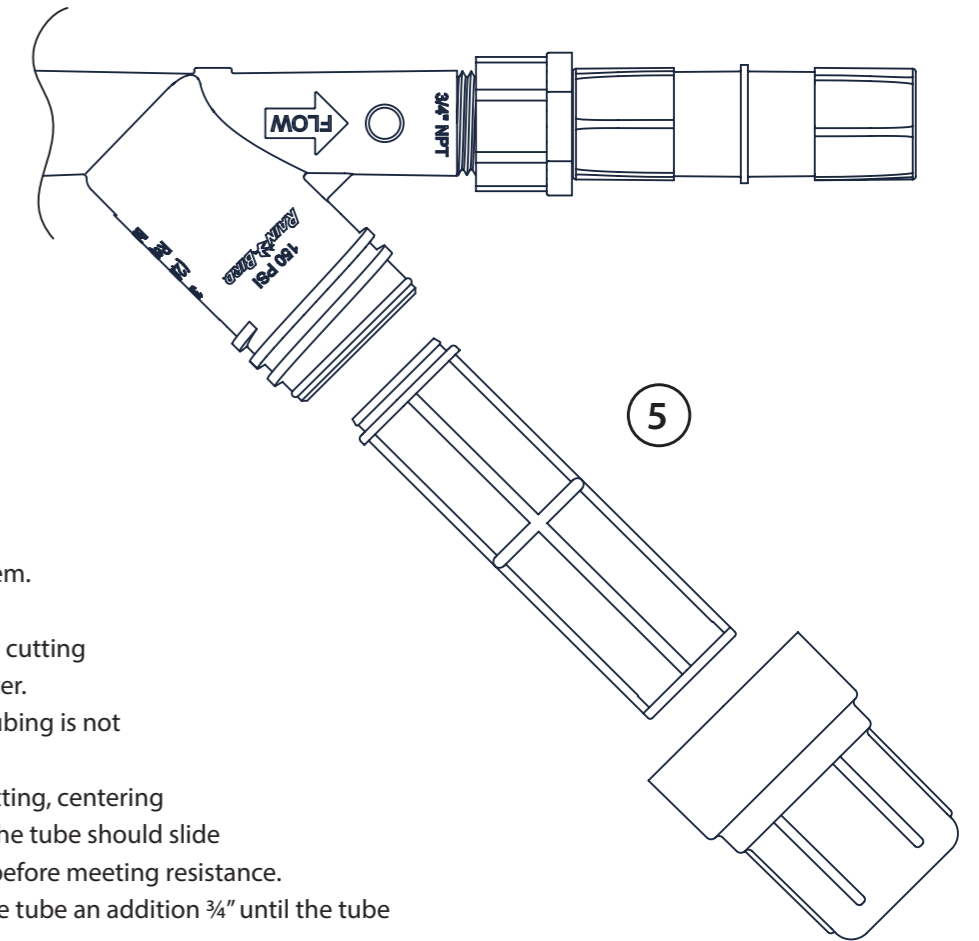

5. Unscrew the cap of the Pressure-Regulating Filter and remove the filter element.
6. Replace cap without filter element.
7. Activate flow through the valve either manually or using the controller. To manually activate, turn the solenoid handle counter-clockwise ½ to ¾ turns.
8. Run water several minutes to flush the system.
9. Replace the filter element.
10. Prepare poly tubing 16mm to 18mm OD by cutting the tubing at least 1 ½" away from any emitter.
11. Check to see that the cut is clean and the tubing is not deformed (out of round).
12. Insert the tubing into the multi-diameter fitting, centering the tube on the white insert of the fitting. The tube should slide freely into the fitting for approximately ½" before meeting resistance.
13. After initial resistance, continue to insert the tube an addition ¾" until the tube reaches a full stop.

Note: Multi-diameter fittings cannot be reused.

Operation / Maintenance

Periodically check the filter to be sure it is not clogged:

1. Periodically remove the filter element.
2. If dirty, rinse the filter element in water before reinstalling.

Winterization

In a freezing climate, water should be removed from the irrigation system before freezing occurs. For more information, please refer to Rain Bird's Winterization Guide, available at www.rainbird.com.

Technical Assistance

Internet: www.rainbird.com
Toll Free: 800-247-3782

Thank you for using our products.